


D  
C  
B  
A

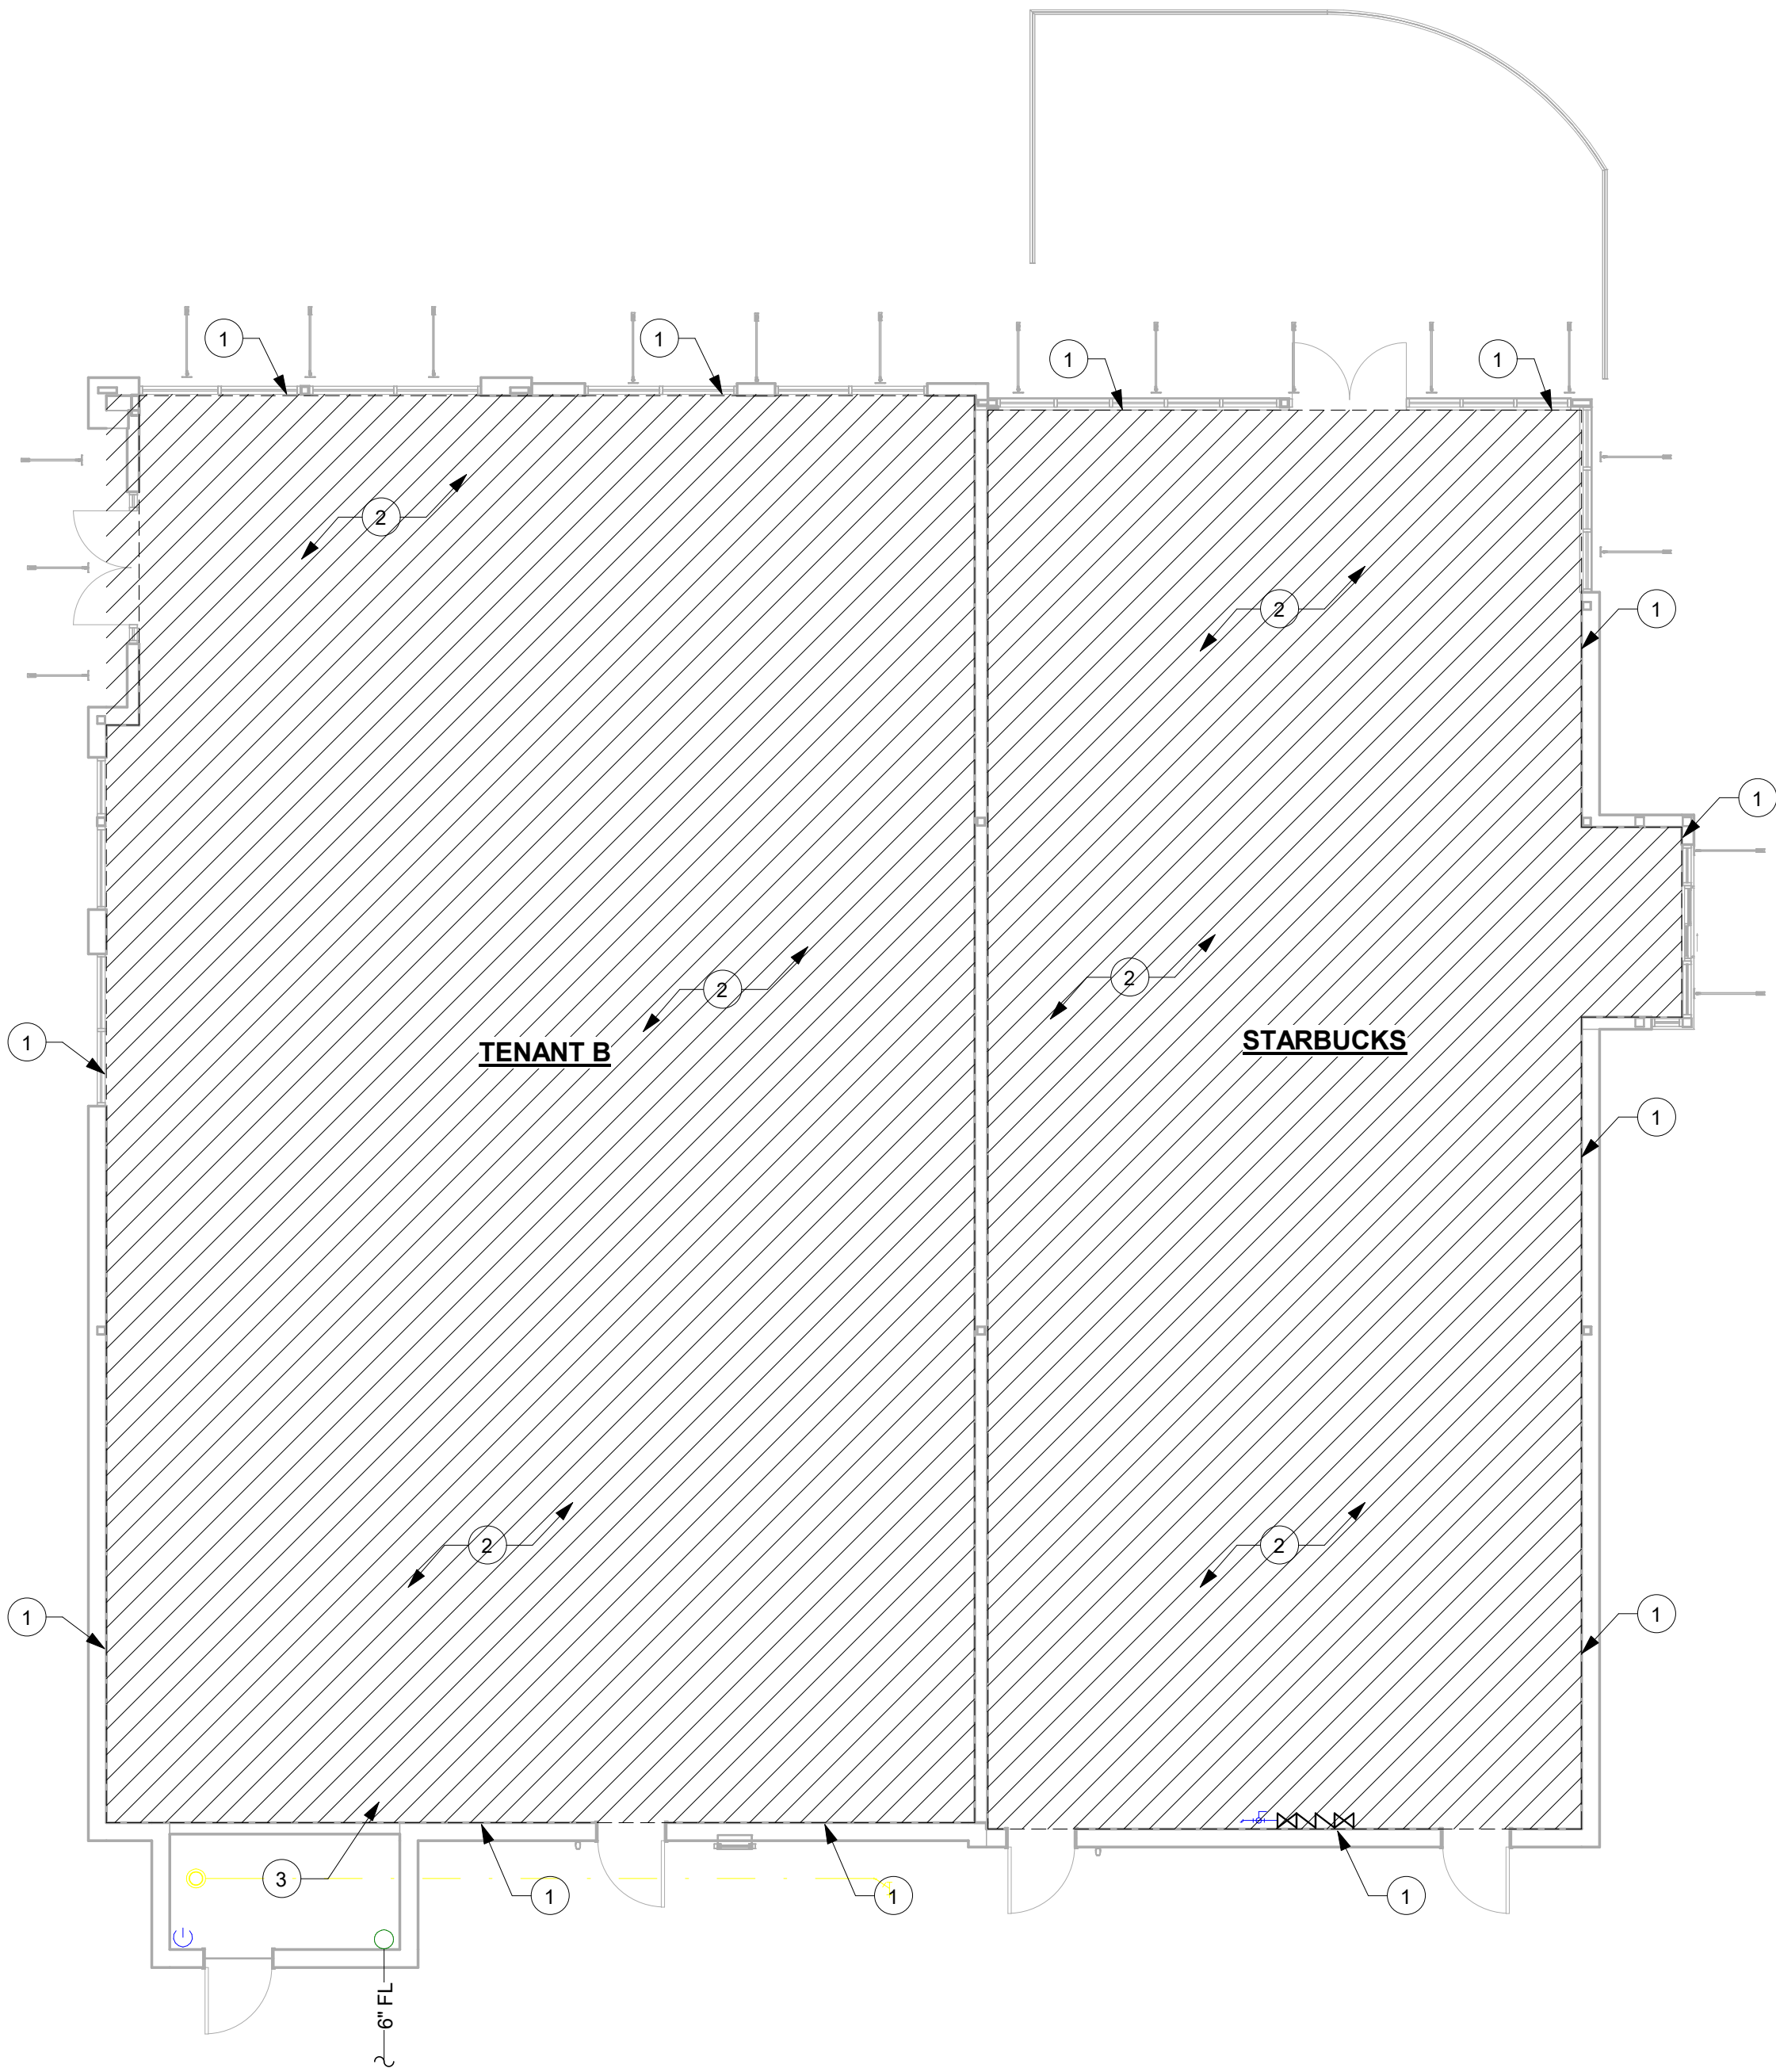

1 FIRE PROTECTION PLAN  
Scale: 1/8" = 1'-0"

PLUMBING SUPPLY PLAN NOTES

- A. THIS DRAWING IS FOR REFERENCE ONLY. A LICENSED FIRE PROTECTION CONTRACTOR SHALL DESIGN AND INSTALL A WET PIPE SPRINKLER SYSTEM IN COMPLIANCE WITH N.F.P.A. 13, THE STATE PLUMBING CODE, AND ALL OTHER APPLICABLE CODES AND ORDINANCES. FLUSH AND COMMISSION SYSTEM, AND OBTAIN ALL FINAL APPROVALS FROM THE STATE AND LOCAL AUTHORITIES.
- B. PROVIDE DESIGN BUILD SYSTEM TO MEET REQUIREMENTS SHOWN. PREPARE HYDRAULIC CALCULATIONS AND DESIGN DRAWINGS. OBTAIN ALL PERMITS, INSPECTIONS, AND APPROVALS.
- C. FIRE PROTECTION CONTRACTOR SHALL SIZE PIPING AND HYDRAULICALLY CALCULATE PER N.F.P.A. 13.
- D. ALL MATERIALS SHALL BE UL AND/OR FM APPROVED AND SHALL BE INSTALLED PER N.F.P.A. 13.
- E. ALL SPRINKLER HEADS SHALL BE CONCEALED PENDANT TYPE.

SHEET NOTES


1. PROVIDE AND INSTALL AUTOMATIC SPRINKLER LINES AND SPRINKLER HEADS WITHIN DASHED OUTLINED AREA, UNLESS NOTED OTHERWISE. AUTOMATIC SPRINKLER SYSTEM SHALL BE HYDRAULICALLY CALCULATED AND SIZED FOR LIGHT HAZARD OCCUPANCY PER N.F.P.A. 13, UNLESS NOTED OTHERWISE. COORDINATE WITH ARCHITECTURAL CEILING PLANS.
2. SPRINKLE DIAGONAL HATCHED AREA ORDINARY HAZARD GROUP I.
3. CONNECT TO EXISTING FIRE MAIN IN BUILDING, VERIFY EXACT SIZE, LOCATION, AND FLOW PRIOR TO START OF ANY WORK.

NOTES

- 1.) SPACE HAS AN EXISTING SPRINKLER SYSTEM. SPRINKLER CONTR SHALL REARRANGE EXISTING HEADS AND IS RESPONSIBLE FOR THE ADDITION OR DELETING OF SPRINKLER HEADS AND PIPING.
- 2.) SPRINKLER SYSTEM TO BE INSTALLED BY A LICENSED SPRINKLER CONTRACTOR.
- 3.) CONTRACTOR IS TO COORDINATE PIPING W/WORK OF OTHER TRADES. (HVAC, PLUMBING, FIRE PROTECTION, AND LIGHTING)
- 4.) INSTALL SPRINKLER HEADS TO COORDINATE WITH ARCHITECTURAL REFLECTED CEILING PLAN.
- 5.) FIRE PROTECTION CONTRACTOR SHALL SUBMIT SPRINKLER SHOP DRAWINGS TO ARCHITECT FOR REVIEW AND APPROVAL **PRIOR** TO SUBMITTING TO AUTHORITY HAVING JURISDICTION.
- 6.) DRY PENDENT SPRINKLERS TO BE INSTALLED WITH SPRINKLER BOOT PER TYCO MODEL DSB-1.
- 7.) BFP SIZING AND RISER SIZING BY SPRINKLER CONTRACTOR DURING SHOP DRAWING PROCESS.
- 8.) INCOMING LOCATION OF SPRINKLER RISER BY LANDLORD. FIELD VERIFY EXACT LOCATION.

LEGEND

- SPRINKLER HEAD (PENDENT) ———— ⊕ ————
- DRY PENDANT HEAD ———— ● ————
- SPRINKLER HEAD (UPRIGHT) ———— ⊙ ————

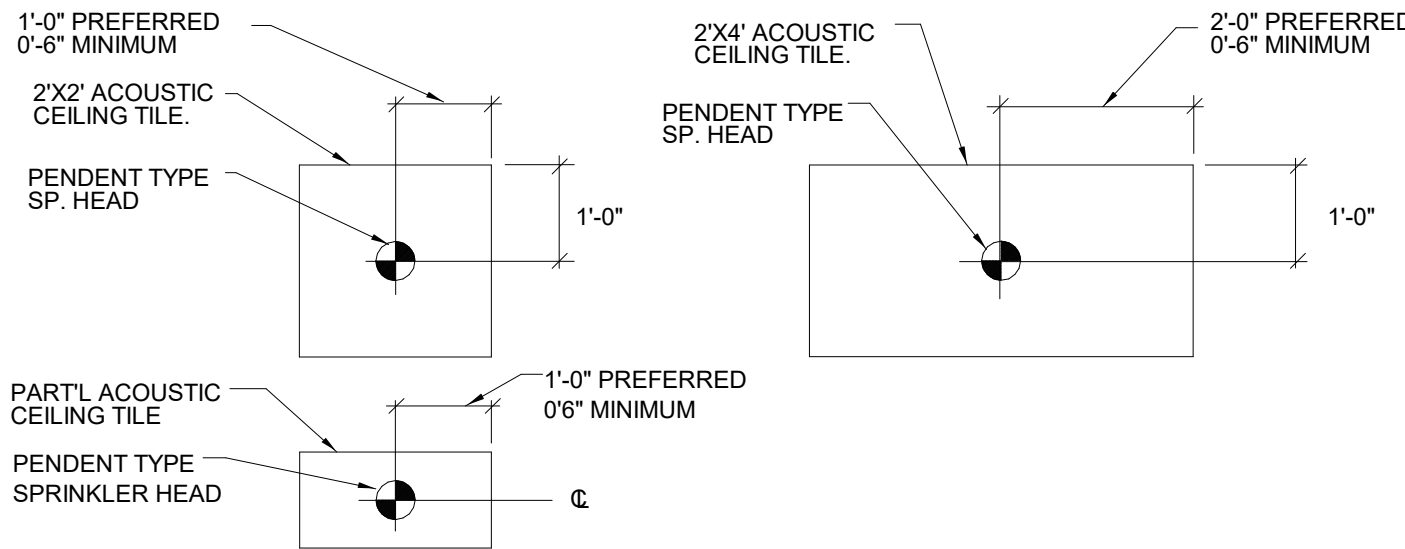

3 SPRINKLER HEAD LOCATION DETAIL  
Scale: 12" = 1'-0"

REV.	DATE	DESCRIPTION
1	08/27/2021	BUILDING DEPARTMENT REVISIONS



MARIETTA HWY & I-575  
5068 MARIETTA HIGHWAY  
CANTON, GA 30114

FIRE PROTECTION PLAN

ISSUED FOR CONSTRUCTION	DATE
BID	
PROJECT MANAGER	DESIGNER
AK	RV

JOB NO.  
2020379.07

M1003