



SANITARY PROFILE S4-EX1

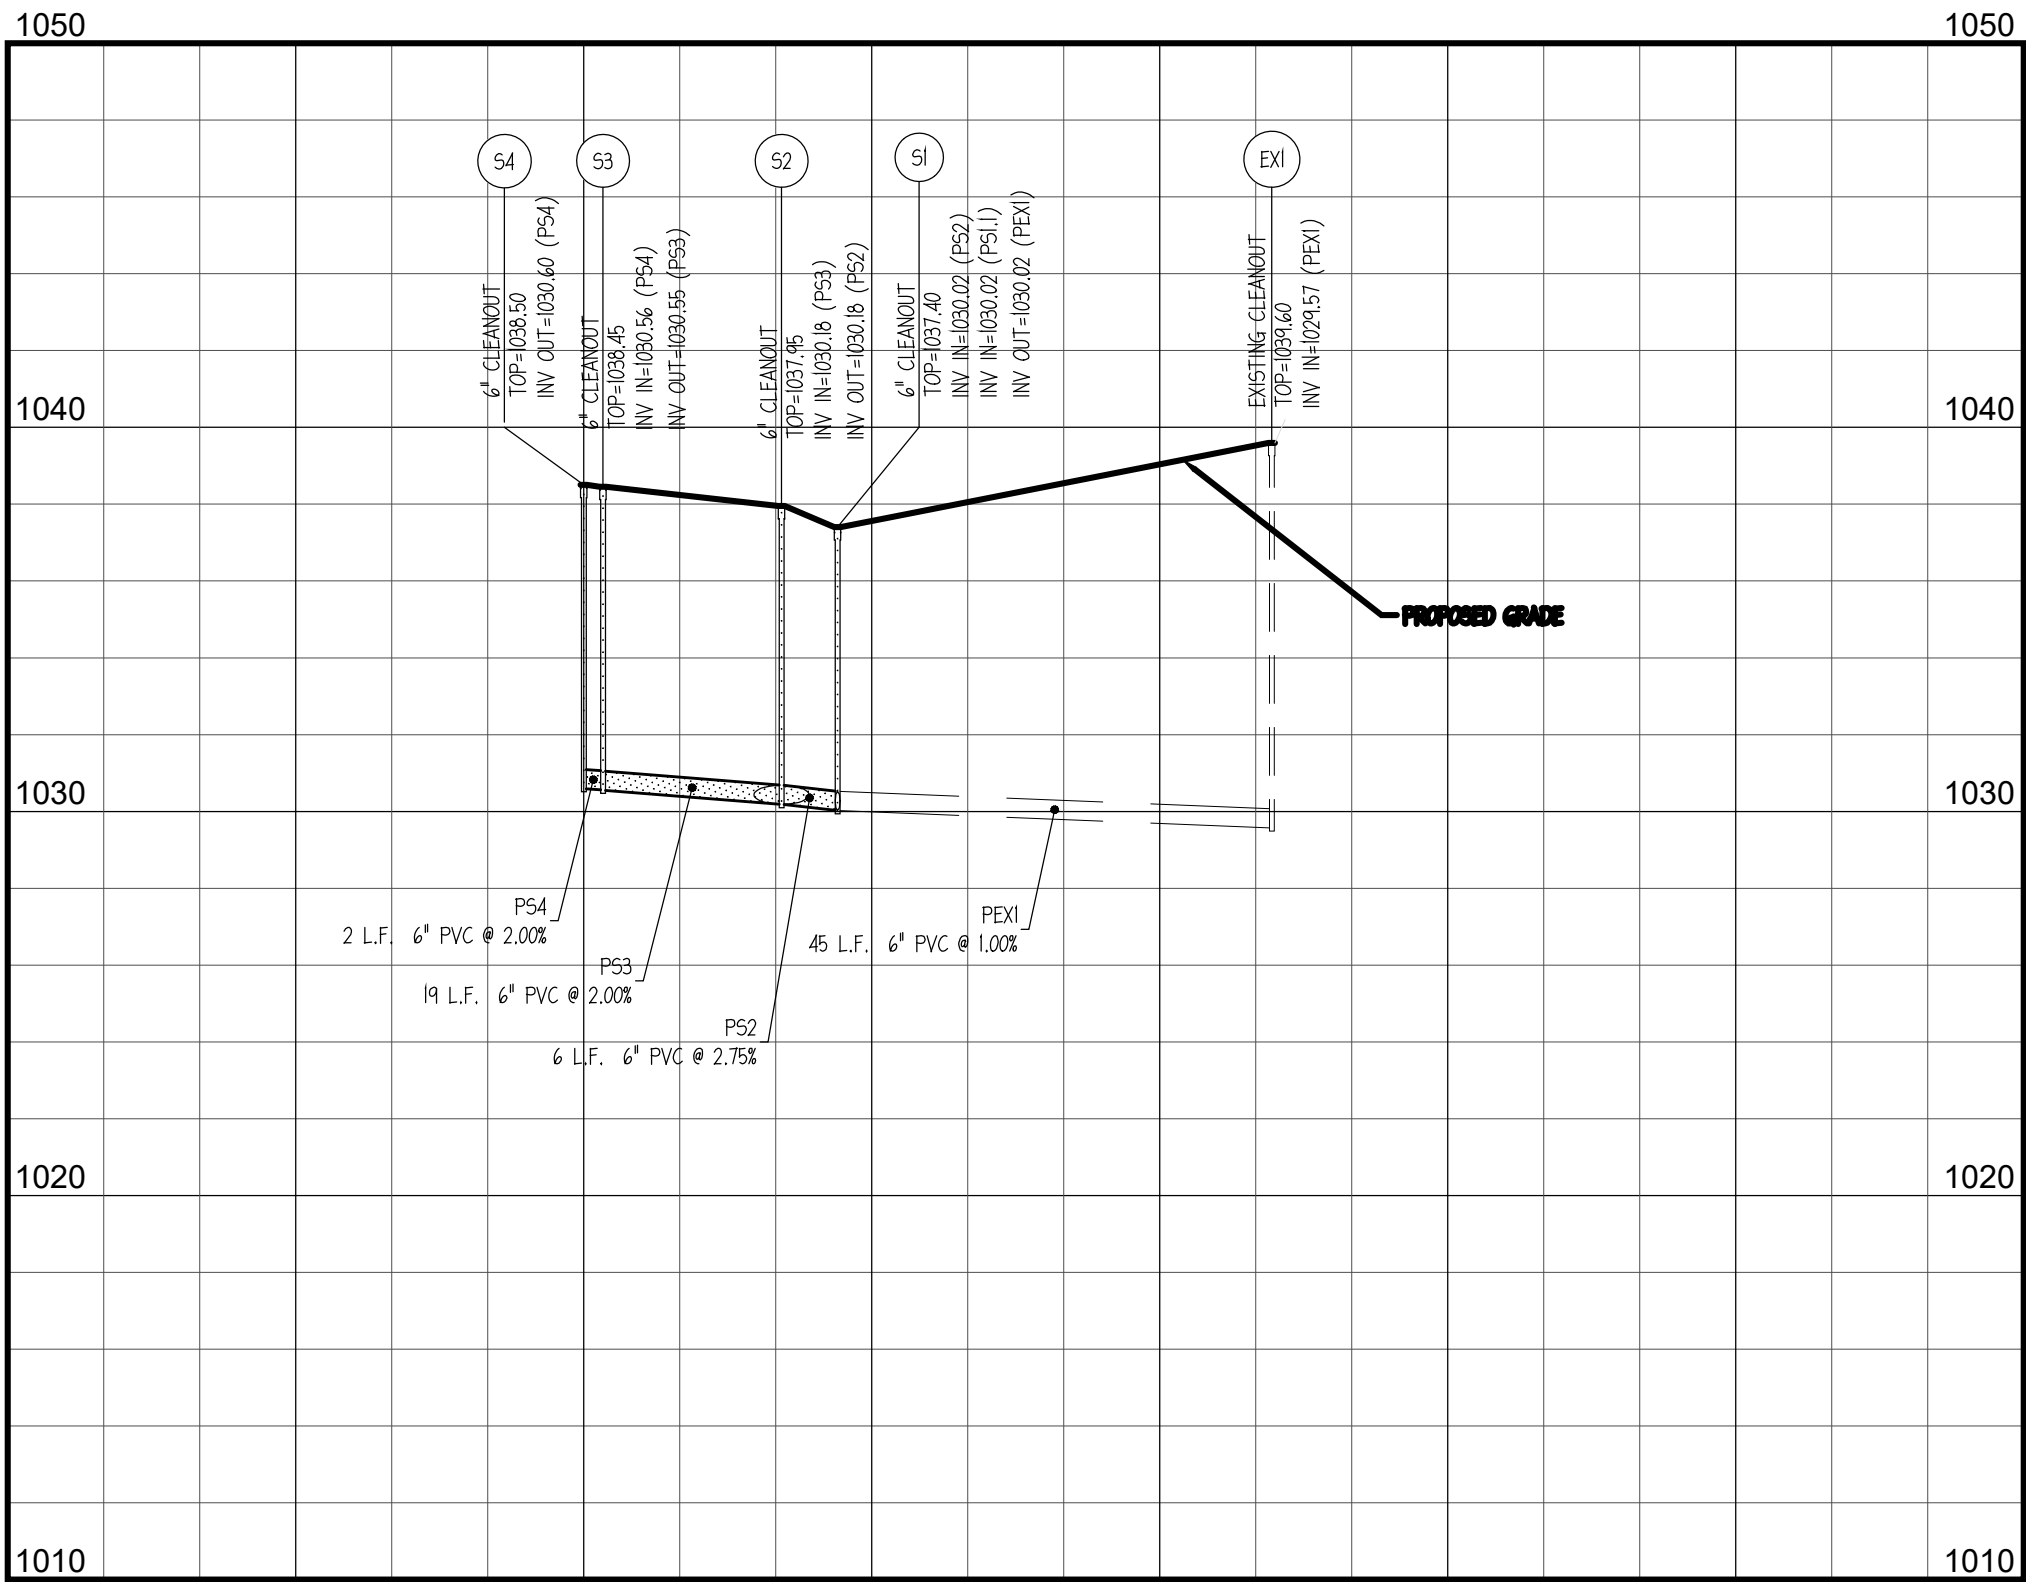

HORIZONTAL SCALE: 1"=20'
VERTICAL SCALE: 1"=5'

SANITARY PROFILE S1.4-S1

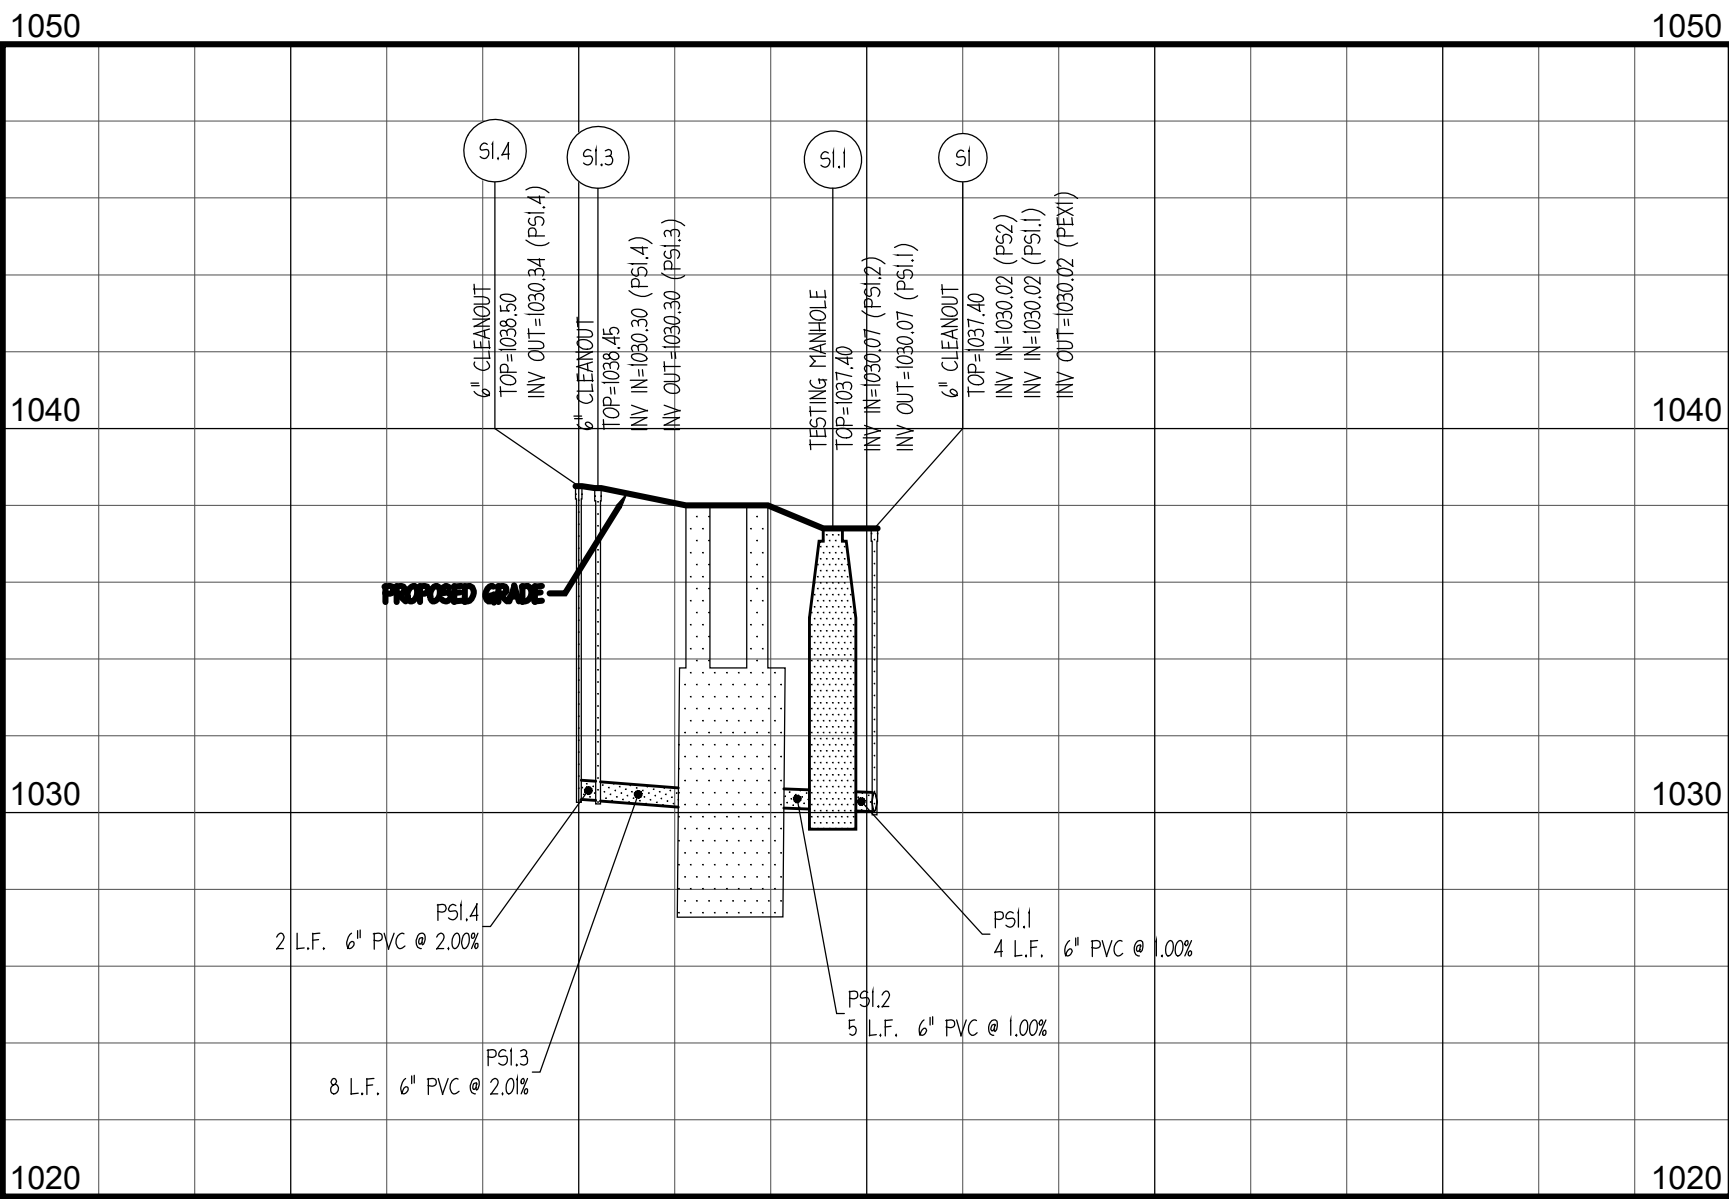

HORIZONTAL SCALE: 1"=20'
VERTICAL SCALE: 1"=5'

SANITARY STRUCTURE TABLE				
STRUCTURE NAME	STRUCTURE TYPE	RIM ELEVATION	INVERT IN	INVERT OUT
EX1	EXISTING CLEANOUT	1039.60	1029.57 (PEX1)	
S1	6" CLEANOUT	1037.40	1030.02 (PS2) 1030.02 (PS1.1)	1030.02 (PEX1)
S1.1	TESTING MANHOLE	1037.40	1030.07 (PS1.2)	1030.07 (PS1.1)
S1.2	GREASE TRAP	0.00		
S1.2 IN	GREASE TRAP IN	1031.49	1030.14 (PS1.3)	
S1.2 OUT	GREASE TRAP OUT	1031.47		1030.12 (PS1.2)
S1.3	6" CLEANOUT	1038.45	1030.30 (PS1.4)	1030.30 (PS1.3)
S1.4	6" CLEANOUT	1038.50		1030.34 (PS1.4)
S2	6" CLEANOUT	1037.95	1030.18 (PS3)	1030.18 (PS2)
S3	6" CLEANOUT	1038.45	1030.56 (PS4)	1030.55 (PS3)
S4	6" CLEANOUT	1038.50		1030.60 (PS4)

SANITARY PIPE TABLE				
NAME	SIZE	LENGTH	SLOPE	MATERIAL
PEX1	6"	45'	1.00%	PVC
PS1.1	6"	4'	1.00%	PVC
PS1.2	6"	5'	1.00%	PVC
PS1.3	6"	8'	2.01%	PVC
PS1.4	6"	2'	2.00%	PVC
PS2	6"	6'	2.75%	PVC
PS3	6"	19'	2.00%	PVC
PS4	6"	2'	2.00%	PVC

PROFILE NOTES

- CONTROLLED BACK FILL TO BE PLACED IN 6" LOOSE LIFT AND COMPACTED TO 100% ASTM D698 PRIOR TO STORM AND SANITARY SEWER CONSTRUCTION. BACK FILL SHALL BE PLACED TO A MINIMUM OF ±2' ABOVE THE CROWN ELEVATION OF THE PIPES.
- STORM DRAIN AND SANITARY SEWER LENGTHS ARE MEASURED FROM CENTER LINE OF STRUCTURE TO CENTERLINE OF STRUCTURE OR FACE OF HEADWALL.
- ALL PIPE LENGTHS SHOWN ARE ROUNDED TO THE NEAREST FOOT.
- ALL STORM DRAIN PIPING SHALL BE TRENCHED, BEDDED AND BACK FILLED ACCORDING WITH DETAIL 1 ON SHEET C04.1 UNLESS SPECIFICALLY NOTED OTHERWISE.
- ALL SANITARY SEWER PIPING SHALL BE TRENCHED, BEDDED AND BACK FILLED ACCORDING WITH DETAIL 1 ON SHEET C04.1 UNLESS SPECIFICALLY NOTED OTHERWISE.
- UNFORESEEN SUBSURFACE CONDITIONS SHALL BE BROUGHT TO THE OWNER'S AND ENGINEER'S ATTENTION IMMEDIATELY IMPLEMENTATION OF CORRECTIVE BEDDING MEASURES WITHOUT THE OWNERS APPROVAL SHALL BE AT THE CONTRACTORS OWN RISK AND AT NO ADDITIONAL COMPENSATION.
- EXISTING GRADES SHOWN ARE APPROXIMATE AND DO NOT REFLECT TOP SOIL REMOVAL, CLEARING, AND GRUBBING OPERATIONS. THE CONTRACTOR SHALL ASCERTAIN FOR HIMSELF THE EXTENT OF DISTURBANCE FOR THESE ACTIVITIES.
- THE CONTRACTOR SHALL REFERENCE THE GEOTECHNICAL REPORT PREPARED FOR THE OWNER FOR SUBSURFACE CONDITIONS. THE GEOTECHNICAL REPORT IS NOT A PART OF THE CONTRACT DOCUMENTS.
- EXCAVATIONS FOR STRUCTURES SHALL BE TAKEN AS A TRENCHING EXCAVATION WITHOUT FURTHER COMPENSATION.
- SEE SHEET C01.1 FOR GENERAL NOTES.



PANDA EXPRESS, INC.

1683 WALNUT GROVE AVE.
ROSEMEAD, CALIFORNIA 91770

TELEPHONE: 626.799.9898
FACSIMILE: 626.372.8268

All ideas, designs, arrangement and plans indicated or represented by this drawing are the property of Panda Express Inc. and were created for use on this specific project. None of these ideas, designs, arrangements or plans may be used by or disclosed to any person, firm, or corporation without the written permission of Panda Express Inc.

REVISIONS:

ISSUE DATE:

PLAN CHECK	03-15-22
ISSUE FOR PERMIT	05-18-22
ISSUE FOR PERMIT	05-31-22
ISSUE FOR PERMIT	06-17-22
ISSUE FOR BID	06-22-22

DRAWN BY: KBS

PANDA PROJECT #: D20180

PANDA STORE #:

CIVIL PROJECT #: 210103



PROFILES

C04.2

CONTRACTOR SHALL VERIFY INVERTS OF
EXISTING SANITARY SEWER LINES